


Texas Drinking Water Watch Water System No. 1230006

LRAA (TTHM/HAA5)


Chemical Results: Sort by: Name Code

TTHM – 2950 HAA5 – 2456

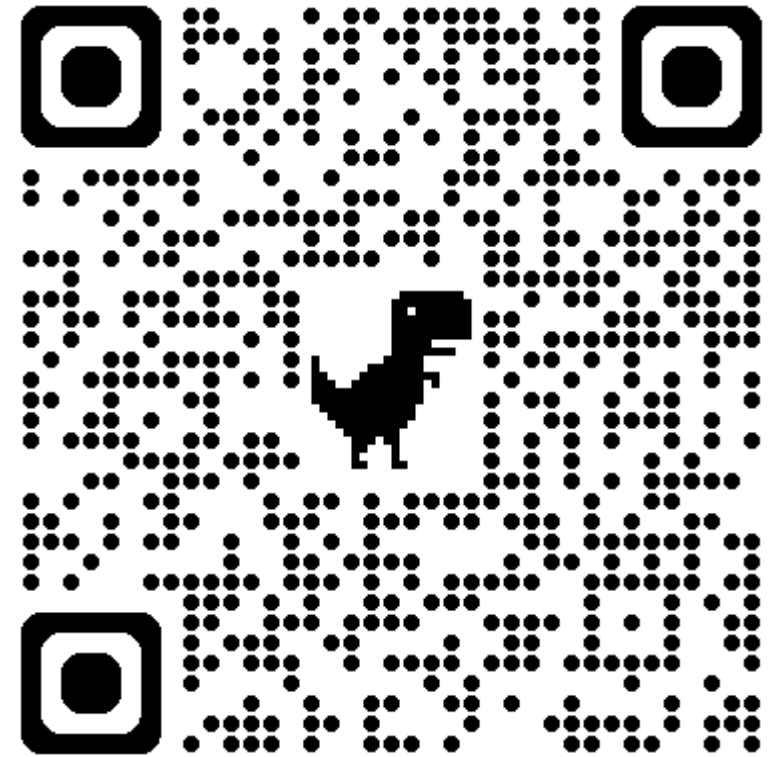

<https://dww2.tceq.texas.gov/DWW/>


TCEQ Texas Drinking Water Watch Instructions

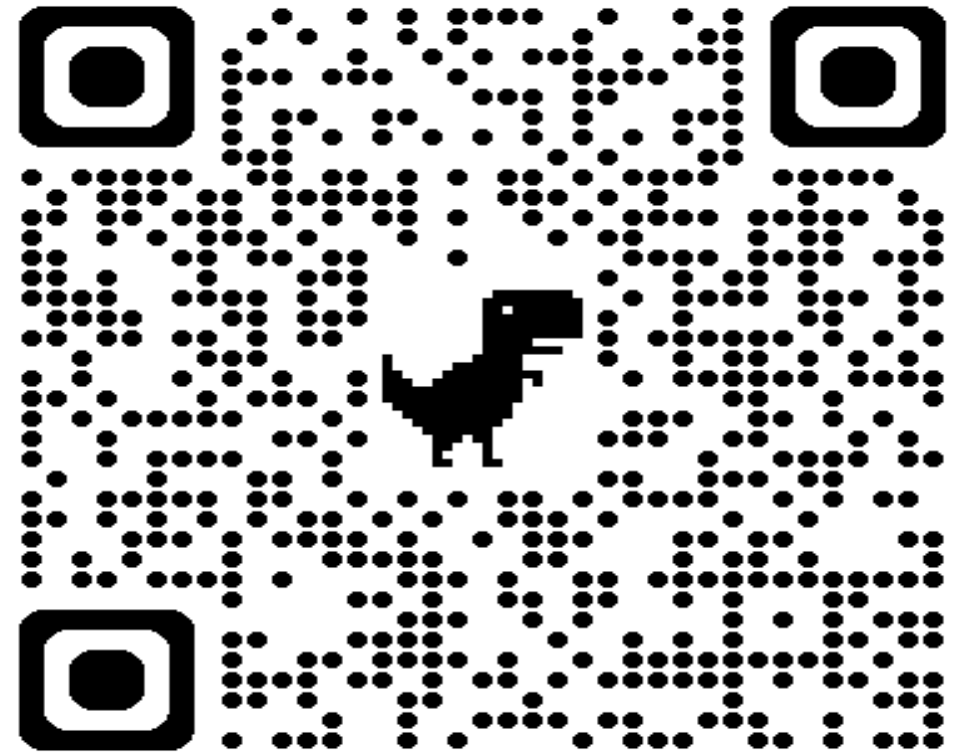

www.tceq.texas.gov/drinkingwater/instructions-for-texas-drinking-water-watch

TCEQ


Disinfection Byproducts
in Public Water Systems

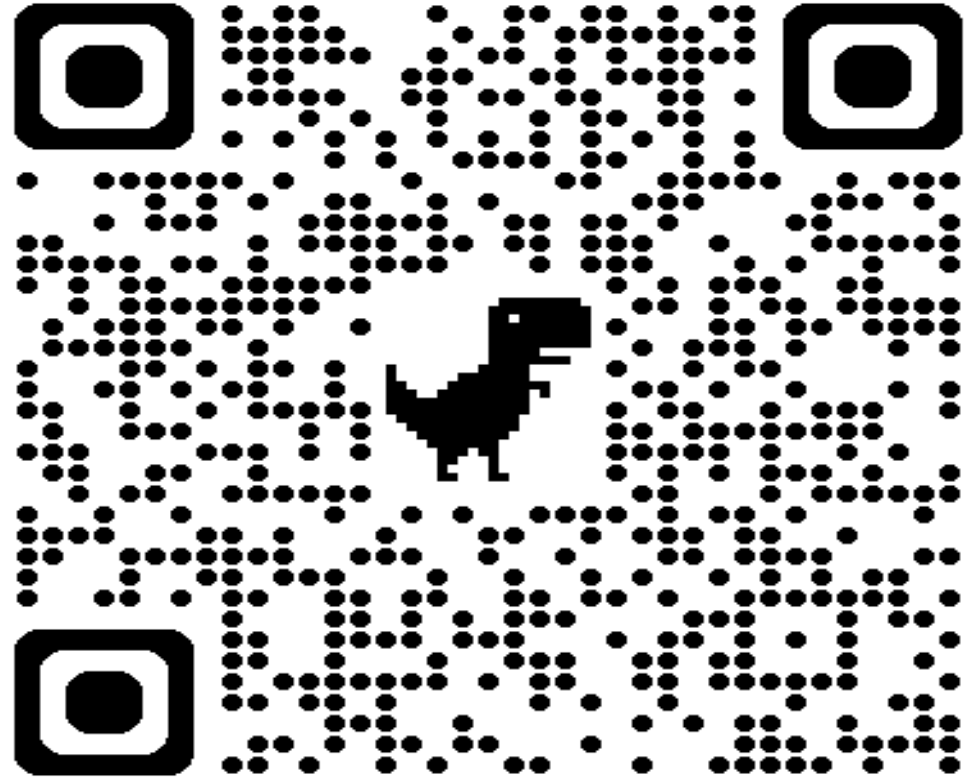

www.tceq.texas.gov/drinkingwater/chemicals/dbp

EPA

Stage 1 and Stage 2 Disinfectants and Disinfection Byproducts Rules

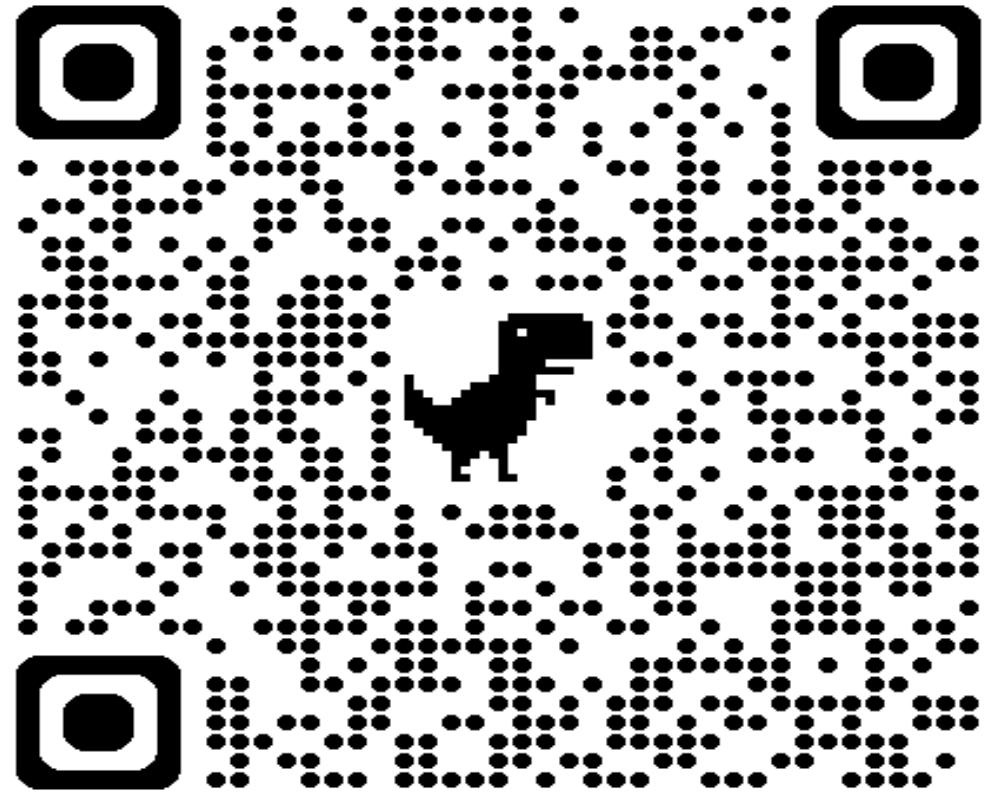

www.epa.gov/dwreginfo/stage-1-and-stage-2-disinfectants-and-disinfection-byproducts-rules

City of Nederland - Surface Water Treatment Plant

Contact information

Supervisor: Michael J Mitchell

Email: MMitchell@ci.Nederland.tx.us

Phone: 409-723-1540